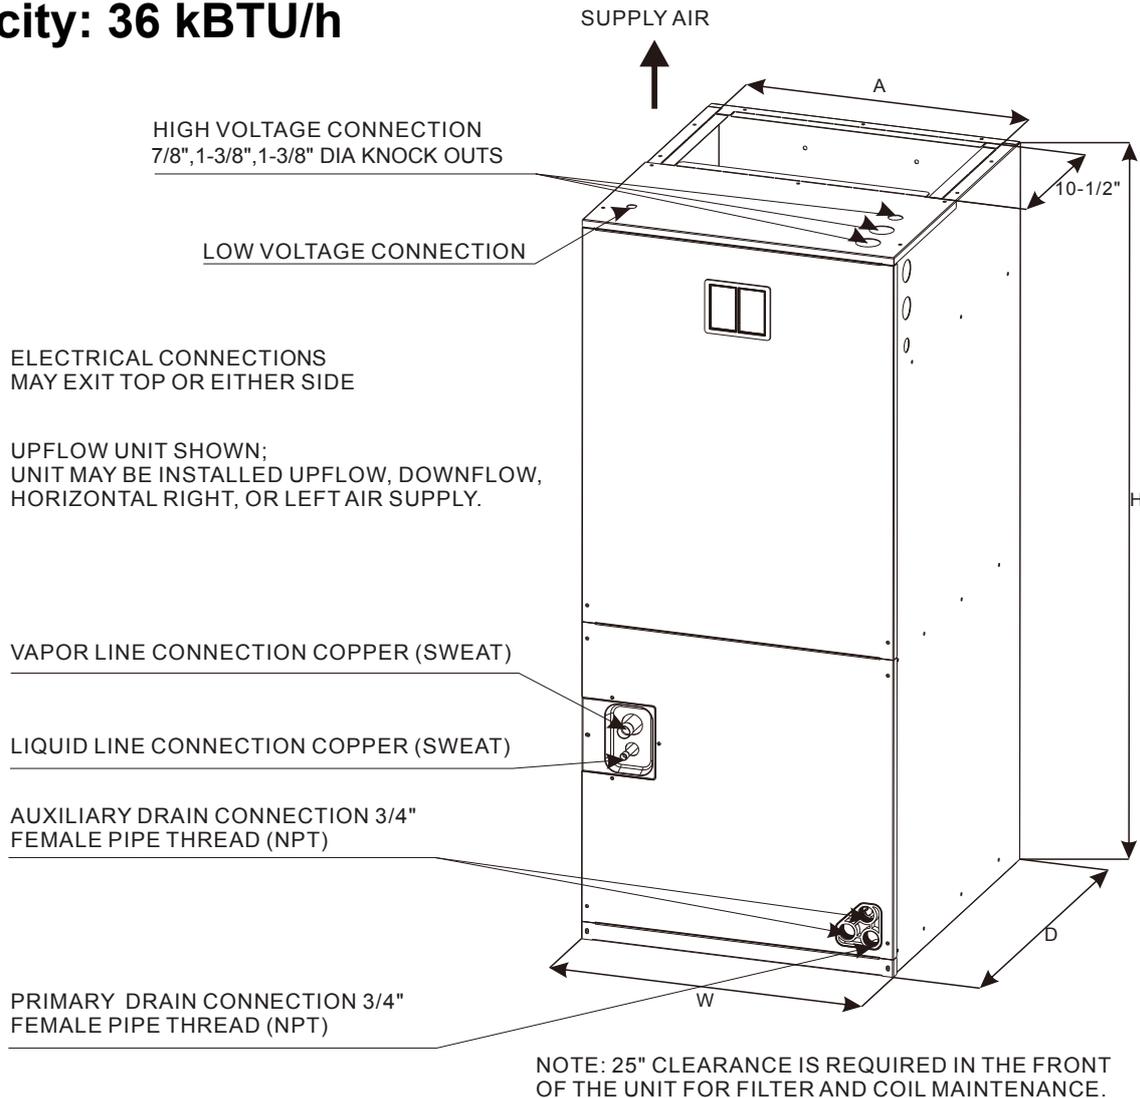


# Submittal

TAG:

## Air Handler AHC3614BA15

**Capacity: 36 kBTU/h**

**DIMENSIONAL DATA**

MODEL SIZE	Dimensions inch[mm]				
	UNIT HEIGHT "H" IN. [mm]	UNIT WIDTH "W" IN. [mm]	UNIT LENGTH "D" IN. [mm]	SUPPLYDUCT "A" IN[mm]	LIQUID LINE/ VAPOR LINE IN
36K	45-3/4"[1162]	19-5/8"[500]	22"[560]	17-7/8"[454]	3/8" / 3/4"



## Product Specifications

<b>INDOOR UNIT</b>	<b>AHC3614BA15</b>
<b>NOMINAL RATING</b>	
Cooling (BTU/h)	33000
External Static(in.w.c.)	0-0.8
<b>ELECTRICAL DATA</b>	
Voltage/Phase/Hz	208/230/1/60
Min. / Max. Voltage	187/253
MCA	4.5
MOP	6
<b>EVAPORATOR COIL</b>	
Type	Copper Tube & Fin
Tube Size(in.)	9/32
Refrigerant Control	Orifice
<b>FAN MOTOR</b>	
Motor Type	ECM
Horsepower (HP)	1/2
Full Load Amps (FLA)	2.8
Capacitor (uF)	/
Rated RPM	1000
<b>REFRIGERATION SYSTEM</b>	
Refrigerant	R454B
Liquid Line Size (O.D.)	3/8
Suction Line Size (O.D.)	3/4
<b>FAN BLOWER</b>	
Type	Centrifugal
Diameter (in.)	11
Height (in.)	11
<b>DIMENSIONS</b>	W×D×H
Unit	19-2/3×22×45-3/4
Packing	22-5/6×25-3/5×47-5/8
<b>WEIGHT</b>	
SHIPPING (LBS.)	141
NET (LBS.)	130



## Airflow Data

Model	Blower Speeds	External Static Pressure (in.w.c.)								
		0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
36K/ 3Ton	1	1080	1015	945	875	810	760	710	640	570
	2	1190	1130	1065	1000	940	880	820	765	715
	3	1310	1260	1205	1150	1100	1035	965	910	860
	4-Factory Default	1430	1385	1337	1290	1245	1190	1130	1060	995
	5	1525	1485	1440	1395	1355	1310	1260	1185	1115

--- Shaded boxes represent airflow outside the required 300-450 cfm/ton, which are not recommended.

Note:

1. The advanced airflow must be used as the rated airflow for the full-load operation of the machine.
2. The rated airflow of a system without an electric heater kit requires 300 to 450 cubic feet of air per minute (CFM).
3. The rated airflow of a system with an electric heater kit requires 350 to 450 cubic feet of air per minute(CFM).
4. The air distribution system has the greatest influence on air flow. Therefore, the contractor should only use the procedures recognized by the industry.
- 5 The design and construction of air duct should be done carefully. Poor design or process will lead to a significant decline in system performance.
6. The air supply duct should be set along the periphery of the air-conditioned space with appropriate size. Improper location of insufficient airflow may lead to insufficient ventilation or noise in the pipeline system.
7. The installer should balance the air distribution system to ensure that all rooms in the room have proper quiet airflow. The speedometer or airflow hood can be used to balance and verify the branch pipe and system airflow (CFM).

## Electrical Data

Electrical Data for Regular Air Handlers					
Model	Heater Kit Usage	MCA (Min. Circuit Ampacity)		MOP (Max. Fuse or Breaker (HACR) Ampacity)	
		208V	230V	208V	230V
AHC3614BA15	WTM0502BE / 5kW	22.8	24.9	25	25
	WTM0802BE / 7.5kW	34.8	37.9	35	40
	WTM1002BE / 10kW	45.4	49.8	50	50
	WTM1502BE / 15kW	34.8/34.8	37.9/37.9	35/35	40/40

Note:

1. Heat kit suitable for AHU 4-way position installation.
2. Ampacities for MCA and Fuse/breaker excluding the blower motor.
3. When model 36 used with electrical heater kit model ZP-HR150-01, you need to ensure that the air volume is not less than 1260 CFM.



## Standard Features :

- a. R454B environmentally friendly refrigerant.
- b. Metal shell and glass cotton thermal insulation layer.
- c. 24V communication.
- d. Multi-Position UP/Down Flow Horizontal Left /Right.
- e. Braze in Refrigerant Connection.
- f. Horizontal and vertical condensate drain pans standard.
- g. Inner-groove copper tube and high-efficiency aluminumfin Coil with Integrated Slide Deck for Easy Removal.
- h. Refrigerant Leakage Detection. Ensure safe use of the unit.
- i. AHRI certified and ETL listed.

## Optional Features :

- a. Electrical heater kits are optional: 5/7.5/10/15/20kW.
- b. TXV is optional.

